



2 1/2" MIN. CURB HEIGHT
Face Angle (See Anchor Detail)

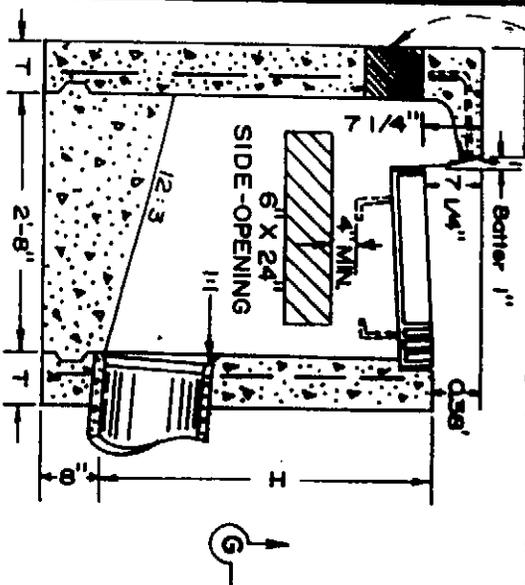

NOTE: For wall thickness (T) see Table A.

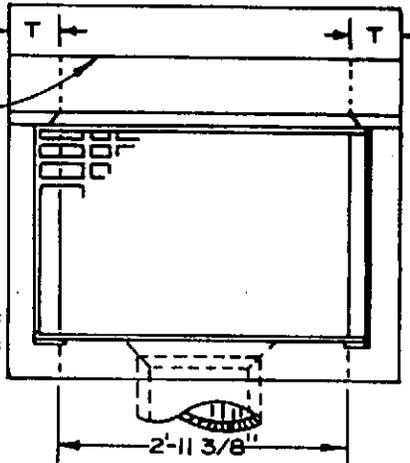

H	T
8'-0" or less	6"
8'-1" to 20'-0"	8"

TABLE A

GENERAL NOTES


1. "H" IS THE DIFFERENCE IN ELEVATION BETWEEN THE OUTLET PIPE FLOWLINE AND THE NORMAL GUTTER GRADE LINE UNDEPRESSED.
2. REINFORCING STEEL IN WALLS SHALL BE #4 BARS AT 18" CENTERS PLACED 1/2" CLEAR TO INSIDE OF BOX UNLESS OTHERWISE SHOWN.
3. STEPS - NONE REQUIRED WHERE "H" IS 3'-6" OR LESS. INSTALL ONE STEP (6" ABOVE FLOOR WHEN "H" IS MORE THAN 3'-6" AND LESS THAN 5'-0" WHERE "H" IS MORE THAN 5'-0" STEPS SHALL BE EVENLY SPACED AT 12" INTERVALS FROM 18" ABOVE FLOOR TO WITHIN 12" OF THE TOP OF BOX. PLACE STEPS IN WALL WITHOUT PIPE OPENINGS.
4. PIPE(S) CAN BE PLACED IN ANY WALL.
5. CURB SECTION SHALL MATCH ADJACENT CURB.
6. BASIN FLOORS SHALL HAVE WOOD TROWEL FINISH AND A MINIMUM SLOPE OF 12:3 FROM ALL DIRECTIONS TOWARD OUTLET PIPE.
7. ALL EQUIPMENT SHALL BE GALVANIZED.
8. WHEN USING STANDARD ROLLED CURB & GUTTER, WARP TO VERTICAL CURB 12.
9. WHEN APRON IS REQUIRED WITH DROP-INLET EXTEND #4 SIDEWALL REBAR 12" INTO TAPERED GUTTER PAN.
10. DELETE APRON IN NON CURB AND GUTTER AREAS.

SECTION G-G

Scoring line when used with curb

PLAN

12' TRANSITION ROLL CURB & GUTTER

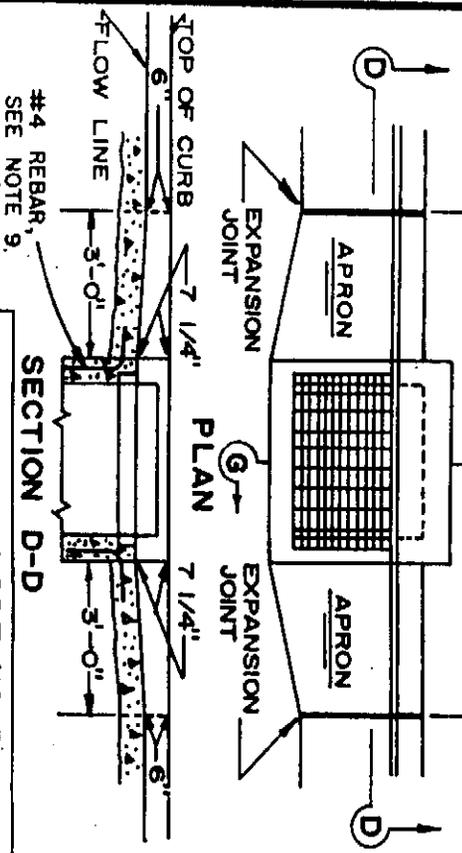


#4 REBAR, SEE NOTE 9.

SECTION D-D

SLOPE NOTES

D. I. GRADE--	ROAD GRD.
MATCH ROAD GRADE	0-4%
HOLD 4% GRADE CHANGE	4-8%
	8%-UP


4% MAX. GRADE CHANGE

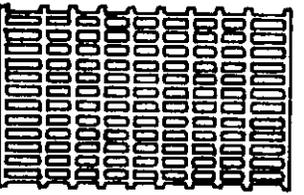


TYPE 24-13 GRATE

NOTE: FRAME & GRATING SHALL CONFORM TO PINKERTON FOUNDRY TYPE A-654 OR EQUAL.


STEP DETAIL

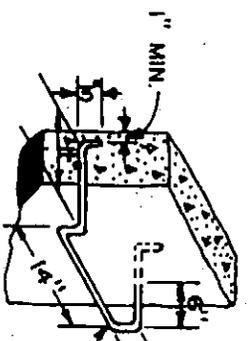

SLOPE SECTION

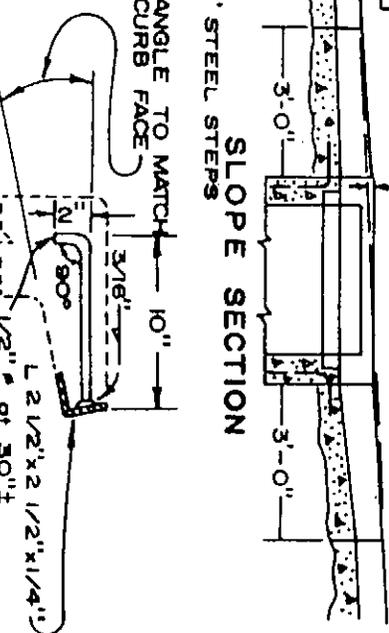

FACE ANGLE ANCHOR DETAIL

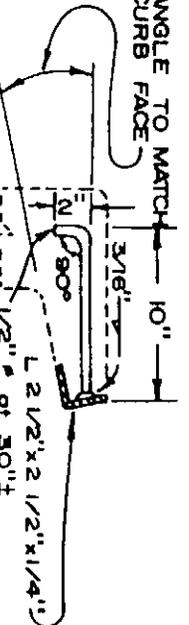

COUNTY OF GLENN — SUBDIVISION STANDARDS

MODIFIED GO TYPE

DROP INLET & DETAILS

REV. DATE DWG. No.

S-7