



H	T
8'-0" OR LESS	6"
8'-1" TO 20'-0"	8"

DEPRESS ROADSIDE DITCH  
FLOWLINE 0.4' AT INLET

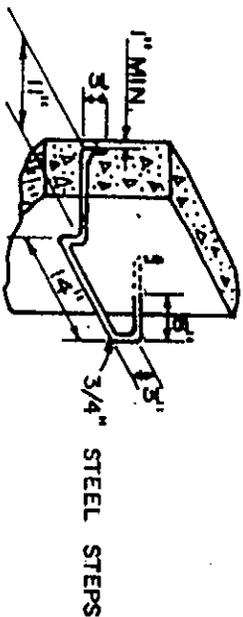


**STEP DETAIL**

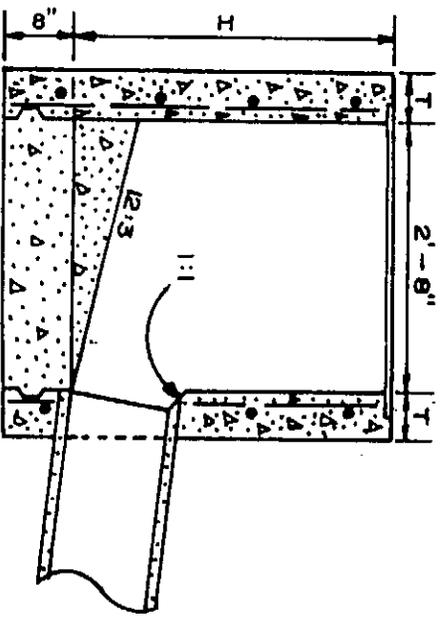

**SECTION F-F**

1. REINFORCING STEEL IN WALLS SHALL BE #4 BARS AT 18" CENTERS PLACED 1 1/2" CLEAR TO INSIDE OF BOX UNLESS OTHERWISE NOTED.
2. STEPS - NONE REQUIRED WHERE "H" IS 3'-6" OR LESS. INSTALL ONE STEP 18" ABOVE FLOOR WHEN "H" IS MORE THAN 3'-6" AND LESS THAN 5'-0". WHEN "H" IS MORE THAN 5'-0" STEPS SHALL BE EVENLY SPACED AT 12" INTERVALS FROM 18" ABOVE FLOOR TO 12" OF THE TOP OF THE BOX. PLACE STEPS IN WALL WITHOUT PIPE OPENING.
3. PIPE (S) CAN BE PLACED IN ANY WALL.
4. BASIN FLOOR SHALL HAVE WOOD TROWEL FINISH AND A MINIMUM SLOPE OF 12/3 FROM ALL DIRECTIONS TOWARD OUTLET PIPE.
5. ALL HARDWARE SHALL BE GALVANIZED.
6. TOP OF COVER AT SAME ELEV. AS E.P.
7. "H" IS THE DIFFERENCE IN ELEVATION BETWEEN THE OUTLET PIPE FLOW LINE AND THE TOP OF COVER.

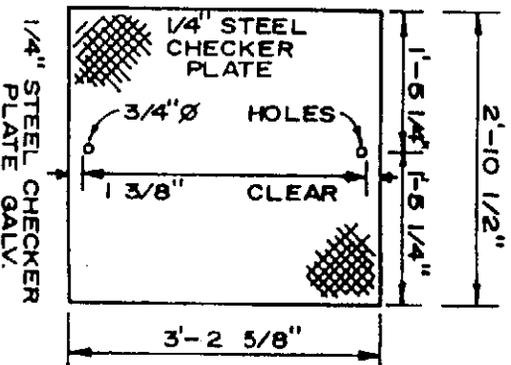

**COVER PLAN**

COUNTY OF GLENN — SUBDIVISION STANDARDS

ALTERNATE MODIFIED G.O.  
TYPE DROP INLET

REV. DATE DWG. NO.

S-8